

1 Extended technical Data

1.1 KACO blueplanet 87.0 TL3

AC-Power

Inverter power nominal	87 kVA
Inverter power maximal	87 kVA
Rated current (In)	132,3 A
Power electronics type	IGBT-MLI (self-commutated)
Rated operating voltage	380 V
cos phi nominal	≈ 1
Grid connection	Three-phase
Impedance bei 165 Hz *	$R_{165\text{ Hz}} \approx 360,0 \Omega$, $X_{165\text{ Hz}} \approx 100,0 \Omega$
Impedance bei 175 Hz *	$R_{175\text{ Hz}} \approx 47,0 \Omega$, $X_{175\text{ Hz}} \approx 360,0 \Omega$

* Scheme in parallel

Operating behaviour in the event of a short circuit at the inverter output

Maximum peak current (Ip)	1,40 x 132,3 A
Maximum peak current (Ik“)	1,02 x 132,3 A

Power quality characteristics

Max. number of switching operations, N ₁₀	10			
Max. number of switching operations, N ₁₂₀	120			
Case of switching operation	Cut-in at 10 % of rated power			
Grid impedance angle	30°	50°	70°	85°
Flicker step factor	0,05	0,05	0,05	0,05
Voltage change factor	1,42	1,42	1,42	1,42
Maximum inrush current factor	0,08			
Maximum inrush current factor (transient only)	0,02			

Case of switching operation	Cut-in at 100 % of rated power			
Grid impedance angle	30°	50°	70°	85°
Flicker step factor	0,12	0,11	0,11	0,11
Voltage change factor	1,42	1,42	1,42	1,42
Maximum inrush current factor	0,33			
Maximum inrush current factor (transient only)	0,02			

Case of switching operation	Service disconnection at rated power			
Description of the service disconnection procedure	Disconnection by the DC-switch			
Grid impedance angle	30°	50°	70°	85°
Flicker step factor	0,80	0,60	0,34	0,13
Voltage change factor	1,42	1,42	1,42	1,42
Maximum inrush current factor	0,94			
Maximum inrush current factor (transient only)	0,04			
Worst case over all switching operations	0,94			
Worst case over all switching operations (transient only)	0,04			
Note: $S_{k, \text{flic}}/S_n$ in the fictitious grid was set to	20			

Flicker	30°	50°	70°	85°
Grid impedance angle	30°	50°	70°	85°
Flicker step factor	0,96	0,94	0,92	0,88
Short term flicker	0,048	0,047	0,046	0,0044
Note: $S_{k, \text{flic}}/S_n$ in the fictitious grid was set to	20			

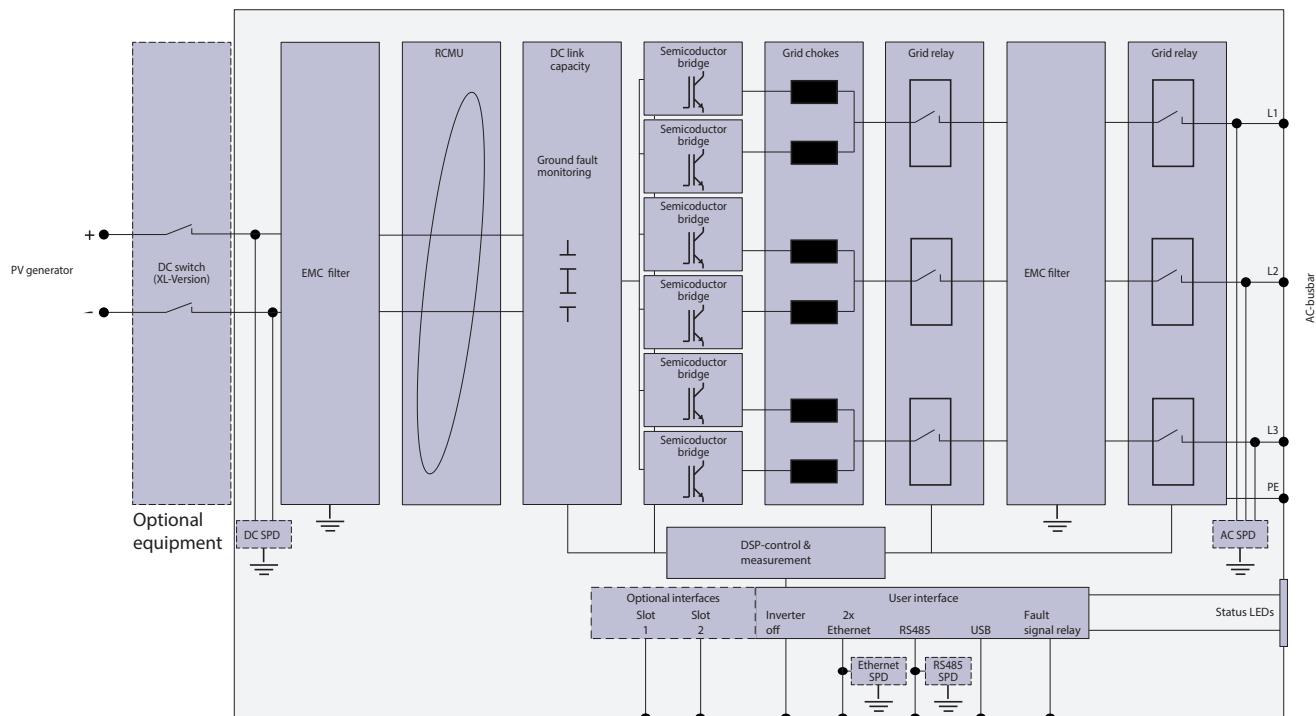


Fig. 1: Block schema blueplanet 87.0-165 TL3

	[A]	[% de In]
1	125,346	94,96
2	0,235	0,18
3	0,086	0,07
4	0,068	0,06
5	0,347	0,32
6	0,049	0,06
7	0,391	0,30
8	0,064	0,06
9	0,048	0,04
10	0,057	0,08
11	0,236	0,18
12	0,07	0,07
13	0,212	0,16
14	0,072	0,07
15	0,053	0,04
16	0,070	0,09
17	0,180	0,14
18	0,054	0,07
19	0,165	0,13
20	0,074	0,06
21	0,055	0,04
22	0,083	0,08
23	0,149	0,11
24	0,058	0,06
25	0,147	0,11
26	0,077	0,06
27	0,054	0,04
28	0,087	0,07
29	0,115	0,09
30	0,059	0,05
31	0,121	0,09
32	0,078	0,06
33	0,054	0,04
34	0,082	0,07
35	0,090	0,07
36	0,057	0,05
37	0,090	0,07
38	0,069	0,05
39	0,049	0,04
40	0,074	0,06
41	0,061	0,05
42	0,049	0,04
43	0,067	0,05
44	0,057	0,04
45	0,041	0,03
46	0,062	0,05

	[A]	[% de In]
47	0,039	0,03
48	0,038	0,03
49	0,044	0,03
50	0,045	0,03

Tab. 1: Harmonics 50 Hz

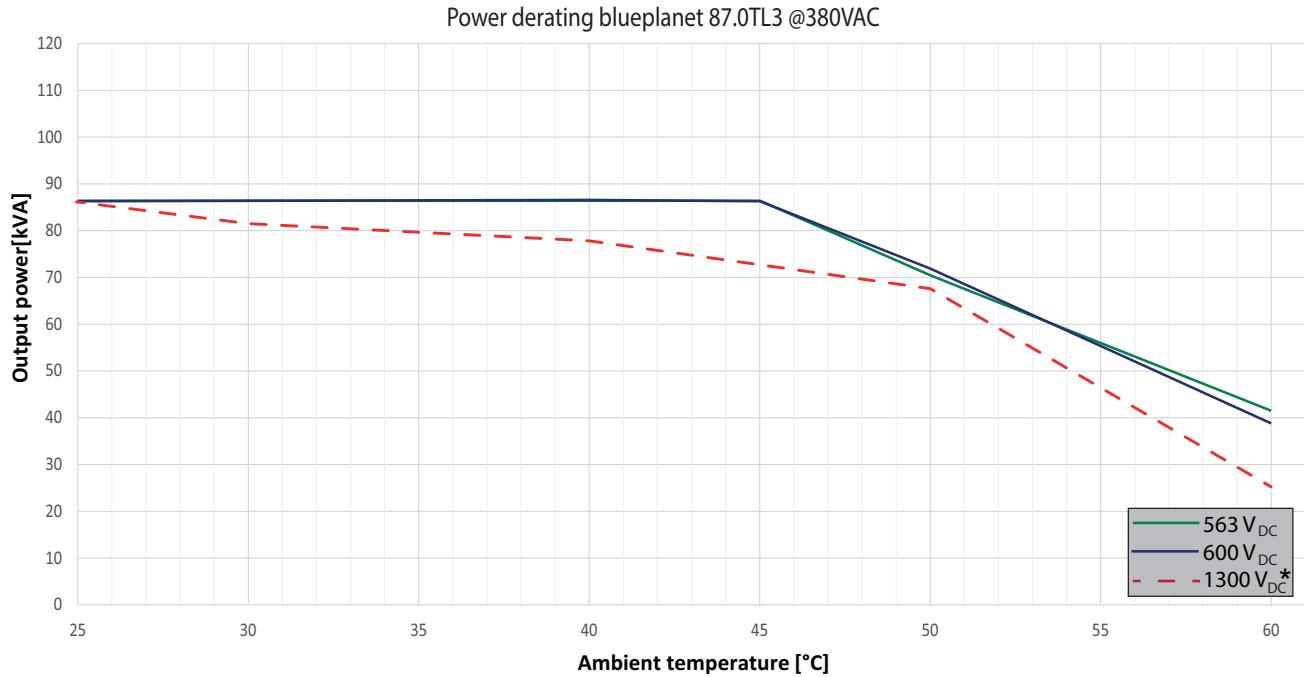


Fig. 2: Power derating blueplanet 87.0 TL3

*) Due to the thermal characteristics of solar modules an operational DC voltage of 1300VDC is not to be expected at higher ambient temperatures in the vast majority of system designs.

Efficiency characteristic

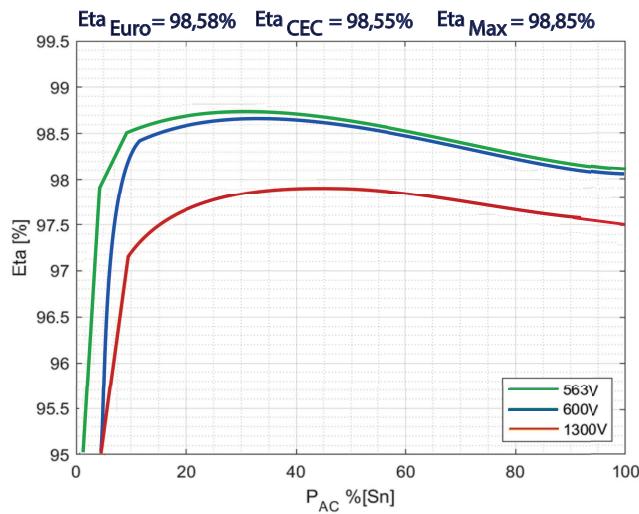


Fig. 3: 2D Diagram blueplanet 87.0TL3

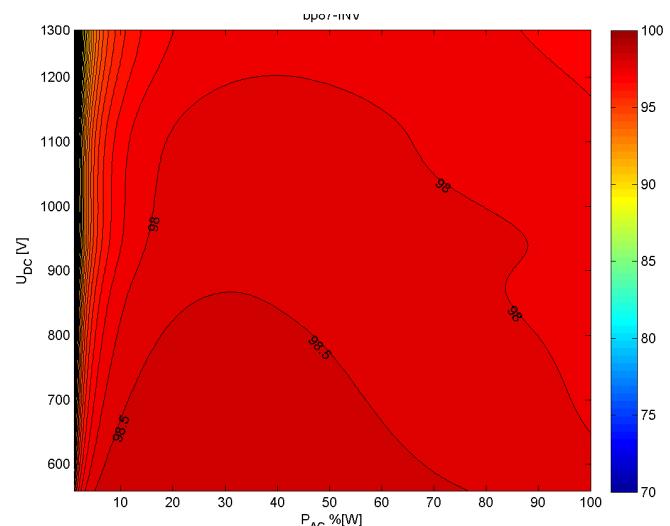


Fig. 4: 3D Diagram blueplanet 87.0TL3

1.2 KACO blueplanet 92.0 TL3

AC-Power

Inverter power nominal	92 kVA
Inverter power max- imal	92 kVA
Rated current (In)	132,3 A
Power electronics type	IGBT-MLI (self-commutated)
Rated operating voltage	400 V
cos phi nominal	≈ 1
Grid connection	Three-phase
Impedance bei 165 Hz *	$R_{165\text{ Hz}} \approx 360,0 \Omega$, $X_{165\text{ Hz}} \approx 100,0 \Omega$
Impedance bei 175 Hz *	$R_{175\text{ Hz}} \approx 47,0 \Omega$, $X_{175\text{ Hz}} \approx 360,0 \Omega$

* Scheme in parallel

Operating behaviour in the event of a short circuit at the inverter output

Maximum peak current (Ip)	1,40 x 132,3 A
Maximum peak current (Ik")	1,02 x 132,3 A

Power quality characteristics

Max. number of switching operations, N ₁₀	10			
Max. number of switching operations, N ₁₂₀	120			
Case of switching operation	Cut-in at 10 % of rated power			
Grid impedance angle	30°	50°	70°	85°
Flicker step factor	0,05	0,05	0,05	0,05
Voltage change factor	1,36	1,36	1,36	1,36
Maximum inrush current factor	0,01			
Maximum inrush current factor (transient only)	0,02			
Case of switching operation	Cut-in at 100 % of rated power			
Grid impedance angle	30°	50°	70°	85°
Flicker step factor	0,22	0,21	0,20	0,19
Voltage change factor	1,36	1,36	1,36	1,36
Maximum inrush current factor	0,30			
Maximum inrush current factor (transient only)	0,02			

Case of switching operation	Service disconnection at rated power			
Description of the service disconnection procedure	Disconnection by the DC-switch			
Grid impedance angle	30°	50°	70°	85°
Flicker step factor	0,92	0,69	0,38	0,14
Voltage change factor	1,36	1,36	1,36	1,36
Maximum inrush current factor	0,08			
Maximum inrush current factor (transient only)	0,04			
Worst case over all switching operations	0,91			
Worst case over all switching operations (transient only)	0,04			
Note: $S_{k, \text{flic}}/S_n$ in the fictitious grid was set to	20			

Flicker	30°	50°	70°	85°
Grid impedance angle	30°	50°	70°	85°
Flicker step factor	1,00	0,98	0,96	0,94
Short term flicker	0,05	0,049	0,048	0,047
Note: $S_{k, \text{flic}}/S_n$ in the fictitious grid was set to	20			

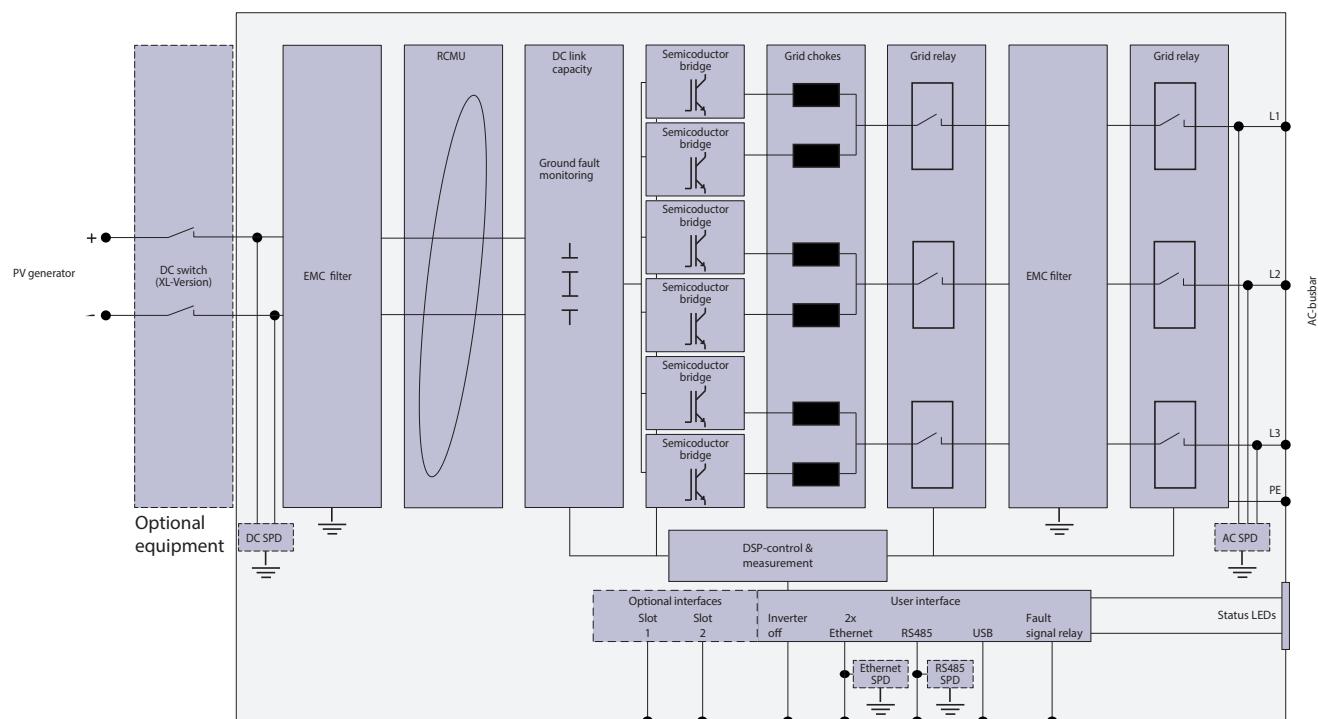


Fig. 5: Block schema blueplanet 87.0-165 TL3

	[A]	[% de In]
1	129,780	98,32
2	0,254	0,19
3	0,092	0,07
4	0,072	0,05
5	0,339	0,33
6	0,064	0,06
7	0,403	0,31
8	0,064	0,05
9	0,046	0,04
10	0,059	0,07
11	0,210	0,17
12	0,052	0,08
13	0,235	0,18
14	0,066	0,06
15	0,046	0,04
16	0,067	0,08
17	0,193	0,15
18	0,061	0,07
19	0,163	0,12
20	0,069	0,06
21	0,043	0,04
22	0,076	0,08
23	0,153	0,12
24	0,061	0,07
25	0,155	0,12
26	0,072	0,06
27	0,045	0,04
28	0,077	0,07
29	0,129	0,10
30	0,061	0,06
31	0,124	0,09
32	0,074	0,06
33	0,042	0,04
34	0,076	0,06
35	0,100	0,08
36	0,059	0,05
37	0,101	0,08
38	0,064	0,05
39	0,043	0,03
40	0,069	0,06
41	0,075	0,06
42	0,048	0,04
43	0,078	0,06
44	0,053	0,04
45	0,038	0,03
46	0,059	0,05

	[A]	[% de In]
47	0,051	0,04
48	0,040	0,03
49	0,052	0,04
50	0,042	0,03

Tab. 2: Harmonics 50 Hz

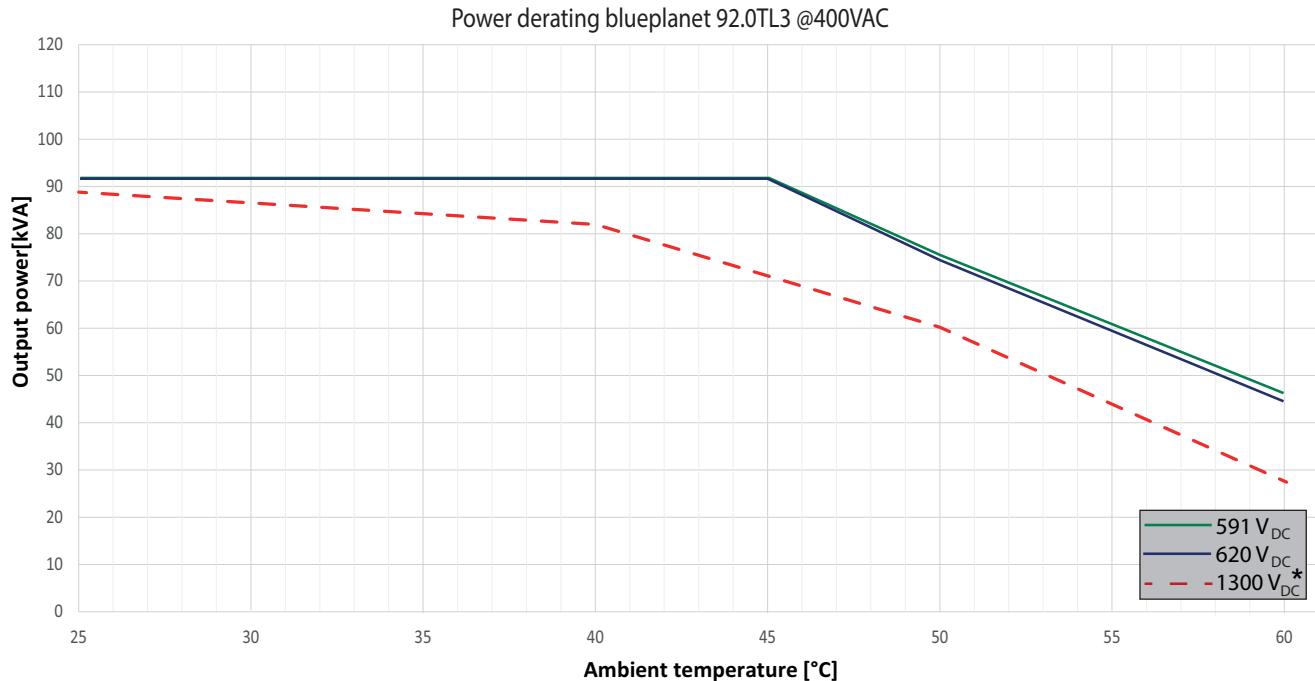


Fig. 6: Power derating blueplanet 92.0 TL3

*) Due to the thermal characteristics of solar modules an operational DC voltage of 1300VDC is not to be expected at higher ambient temperatures in the vast majority of system designs.

Efficiency characteristic

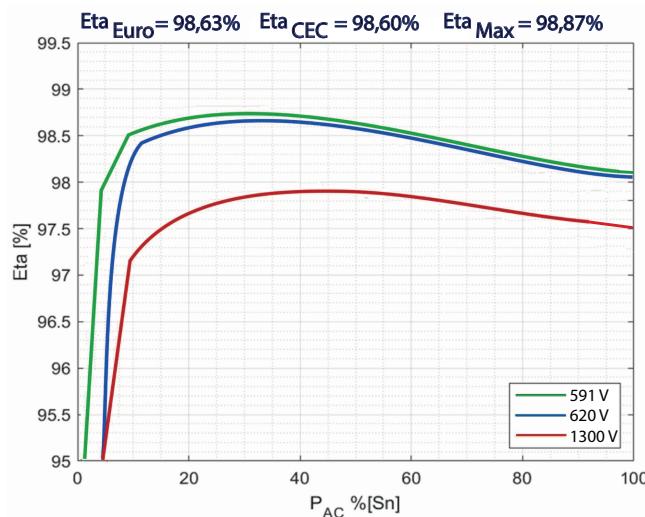


Fig. 7: 2D Diagram blueplanet 92.0 TL3

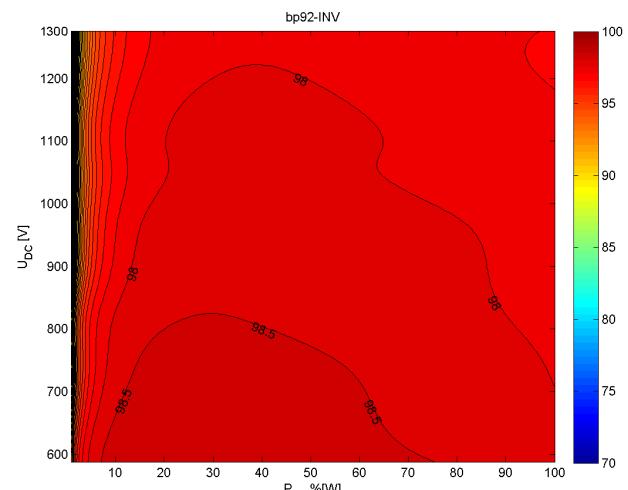


Fig. 8: 3D Diagram blueplanet 92.0TL3

1.3 KACO blueplanet 105 TL3

AC-Power

Inverter power nominal	99,9 kVA
Inverter power maximal	105 kVA
Rated current (In)	152 A
Power electronics type	IGBT-MLI (self-commutated)
Rated operating voltage	400 V
cos phi nominal	≈ 1
Grid connection	Three-phase
Impedance bei 165 Hz *	$R_{165\text{ Hz}} \approx 360,0 \Omega$, $X_{165\text{ Hz}} \approx 100,0 \Omega$
Impedance bei 175 Hz *	$R_{175\text{ Hz}} \approx 47,0 \Omega$, $X_{175\text{ Hz}} \approx 360,0 \Omega$

* Scheme in parallel

Operating behaviour in the event of a short circuit at the inverter output

Maximum peak current (Ip)	260,8 A
Maximum peak current (Ik")	150,8 A

Power quality characteristics

Max. number of switching operations, N ₁₀	10
Max. number of switching operations, N ₁₂₀	120
Case of switching operation	Cut-in at 10 % of rated power
Grid impedance angle	30° 50° 70° 85°
Flicker step factor	0,0253 0,0383 0,0467 0,0493
Voltage change factor	0,0050 0,0050 0,0050 0,0050
Maximum inrush current factor	0,100
Maximum inrush current factor (transient only)	0,020

Case of switching operation	Cut-in at 100 % of rated power
Grid impedance angle	30° 50° 70° 85°
Flicker step factor	0,1609 0,1566 0,1497 0,1433
Voltage change factor	0,0397 0,0397 0,0397 0,0397
Maximum inrush current factor	0,379
Maximum inrush current factor (transient only)	0,020

Case of switching operation	Service disconnection at rated power
Description of the service disconnection procedure	Disconnection by the DC-switch
Grid impedance angle	30° 50° 70° 85°
Flicker step factor	0,3319 0,2547 0,1526 0,0726
Voltage change factor	0,0788 0,0788 0,0788 0,0788
Maximum inrush current factor	0,000
Maximum inrush current factor (transient only)	0,000
Worst case over all switching operations	0,331
Worst case over all switching operations (transient only)	0,040
Note: S _{k, fic} /S _n in the fictitious grid was set to	20

Flicker

	30°	50°	70°	85°
Grid impedance angle				
Flicker step factor	0,62	0,93	1,13	1,18
Short term flicker	0,33	0,49	0,60	0,63

Note: $S_{k, \text{flick}}/S_n$ in the fictitious grid was set to 20

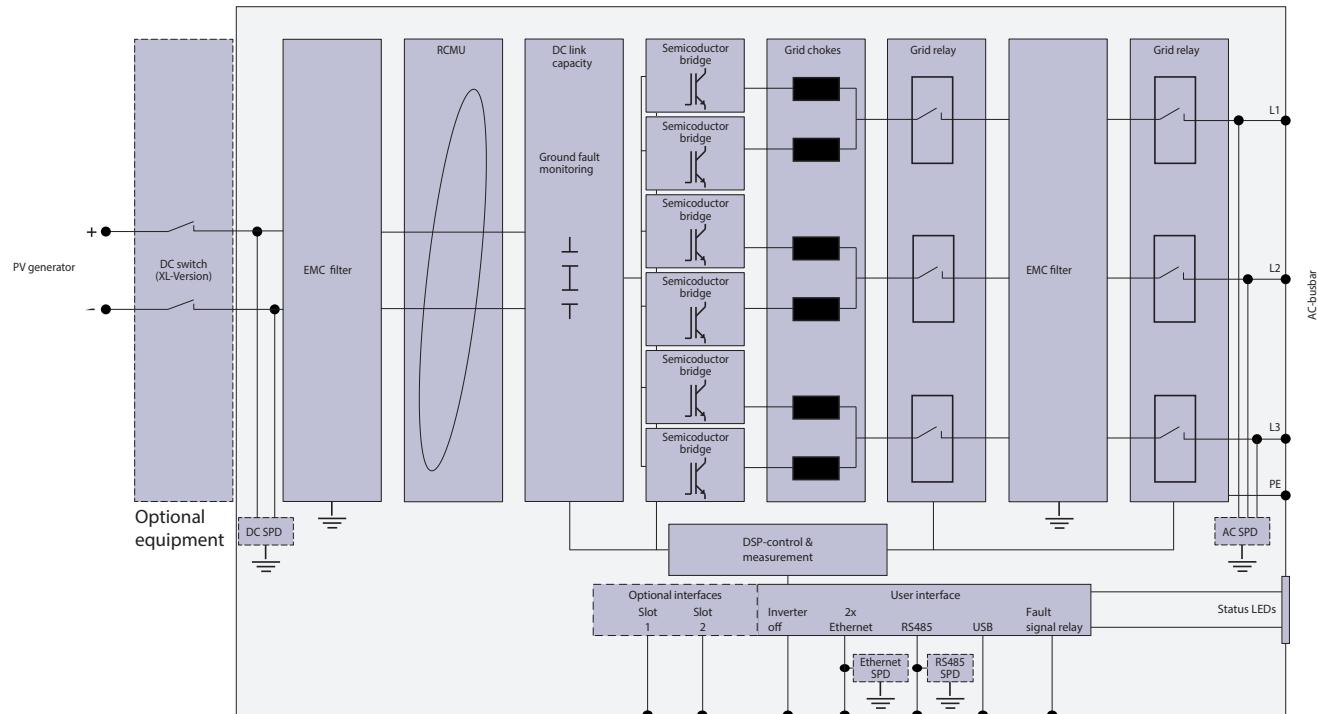


Fig. 9: Block schema blueplanet 87.0-165 TL3

	[A]	[% de In]
1	150,219	98,83
2	0,346	0,23
3	0,112	0,07
4	0,141	0,09
5	0,555	0,37
6	0,114	0,07
7	0,466	0,31
8	0,080	0,05
9	0,074	0,05
10	0,088	0,06
11	0,243	0,16
12	0,123	0,08
13	0,246	0,16
14	0,086	0,06
15	0,091	0,06
16	0,118	0,08
17	0,223	0,15
18	0,120	0,08
19	0,220	0,15
20	0,082	0,05
21	0,080	0,05
22	0,117	0,08
23	0,185	0,12
24	0,096	0,06
25	0,193	0,13
26	0,065	0,04
27	0,078	0,05
28	0,108	0,07
29	0,159	0,10
30	0,076	0,05
31	0,152	0,10
32	0,056	0,04
33	0,065	0,04
34	0,084	0,06
35	0,150	0,10
36	0,056	0,04
37	0,137	0,09
38	0,052	0,03
39	0,055	0,04
40	0,057	0,04
41	0,133	0,09
42	0,053	0,03
43	0,117	0,08
44	0,044	0,03
45	0,032	0,02
46	0,035	0,02

	[A]	[% de In]
47	0,107	0,07
48	0,054	0,04
49	0,092	0,06
50	0,035	0,02

Tab. 3: Harmonics 50 Hz

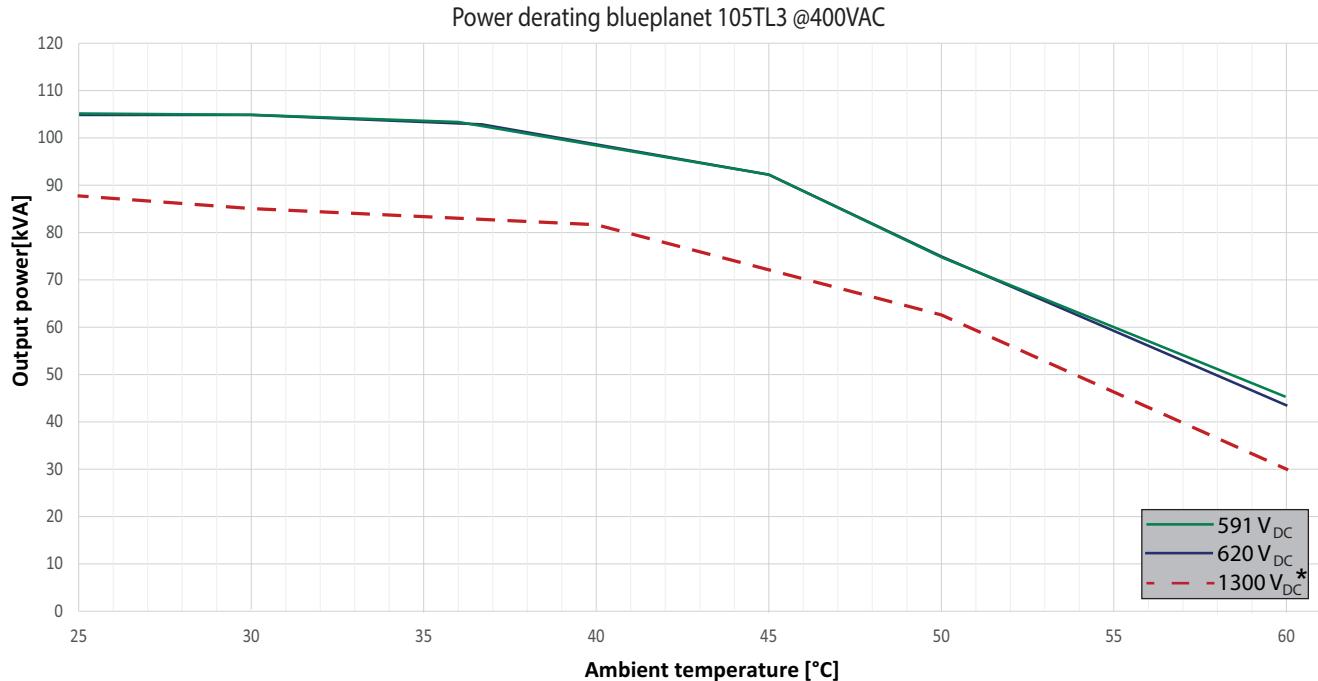


Fig. 10: Power derating blueplanet 105TL3

* Due to the thermal characteristics of solar modules an operational DC voltage of 1300VDC is not to be expected at higher ambient temperatures in the vast majority of system designs.

Efficiency characteristic

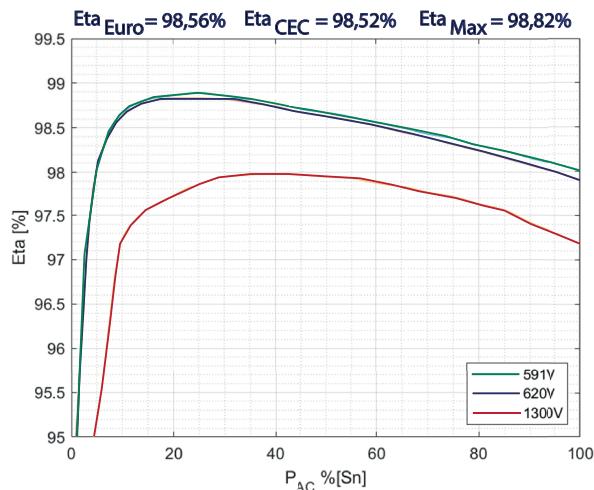


Fig. 11: 2D Diagram blueplanet 105 TL3

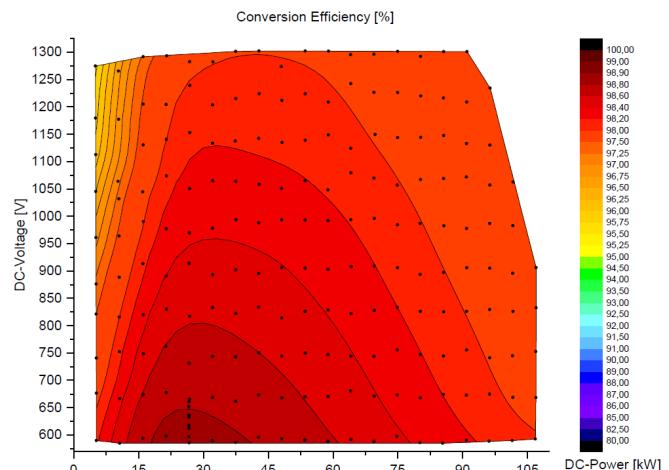


Fig. 12: 3D Diagram blueplanet 105 TL3

1.4 KACO blueplanet 110 TL3

AC-Power

Inverter power nominal	110 kVA
Inverter power maximal	110 kVA
Rated current (In)	132,3 A
Power electronics type	IGBT-MLI (self-commutated)
Rated operating voltage	480 V
cos phi nominal	≈ 1
Grid connection	Three-phase
Impedance bei 165 Hz *	$R_{165\text{ Hz}} \approx 360,0 \Omega$, $X_{165\text{ Hz}} \approx 100,0 \Omega$
Impedance bei 175 Hz *	$R_{175\text{ Hz}} \approx 47,0 \Omega$, $X_{175\text{ Hz}} \approx 360,0 \Omega$

* Scheme in parallel

Operating behaviour in the event of a short circuit at the inverter output

Maximum peak current (Ip)	1,40 x 132,3 A
Maximum peak current (Ik")	1,02 x 132,3 A

Power quality characteristics

Max. number of switching operations, N ₁₀	10
Max. number of switching operations, N ₁₂₀	120
Case of switching operation	Cut-in at 10 % of rated power
Grid impedance angle	30° 50° 70° 85°
Flicker step factor	0,04 0,03 0,03 0,03
Voltage change factor	0,26 0,23 0,19 0,18
Maximum inrush current factor	0,029
Maximum inrush current factor (transient only)	0,02

Case of switching operation	Cut-in at 100 % of rated power			
Grid impedance angle	30°	50°	70°	85°
Flicker step factor	0,05	0,05	0,05	0,05
Voltage change factor	0,97	0,71	0,38	0,24
Maximum inrush current factor	0,028			
Maximum inrush current factor (transient only)	0,02			

Case of switching operation	Service disconnection at rated power			
Description of the service disconnection procedure	Disconnection by the DC-switch			
Grid impedance angle	30°	50°	70°	85°
Flicker step factor	0,56	0,41	0,33	0,31
Voltage change factor	1,06	0,75	0,42	0,49
Maximum inrush current factor	0,904			
Maximum inrush current factor (transient only)	0,04			
Worst case over all switching operations	0,904			
Worst case over all switching operations (transient only)	0,04			
Note: S _{k, fic} /S _n in the fictitious grid was set to	20			

Flicker

	30°	50°	70°	85°
Grid impedance angle				
Flicker step factor	1,12	1,32	1,50	1,57
Short term flicker	0,056	0,066	0,075	0,0785

Note: $S_{k, \text{flick}}/S_n$ in the fictitious grid was set to 20

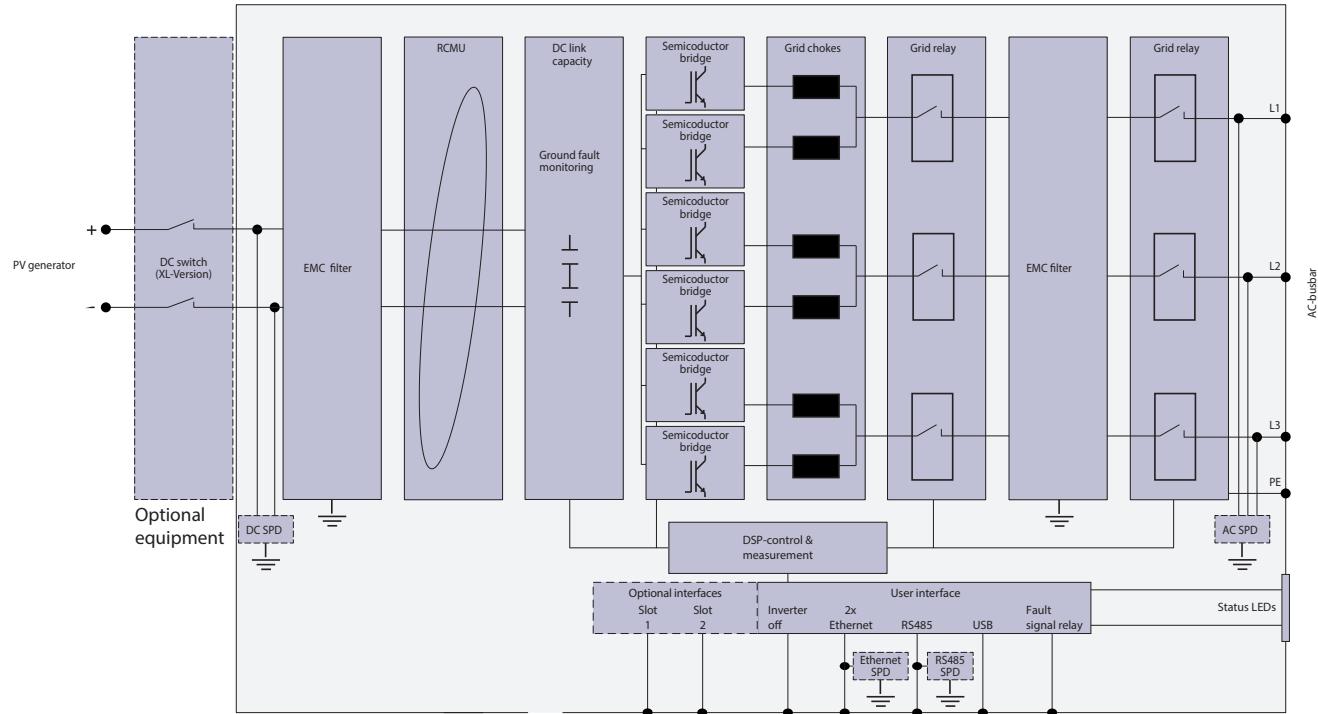


Fig. 13: Block schema blueplanet 87.0-165 TL3

	50 Hz		60 Hz	
	[A]	[% de ln]	[A]	[% de ln]
1	126,433	95,78	118,112	89,28
2	0,260	0,20	0,260	0,20
3	0,125	0,09	0,115	0,09
4	0,072	0,06	0,097	0,07
5	0,370	0,40	0,404	0,59
6	0,097	0,07	0,068	0,07
7	0,302	0,35	0,355	0,41
8	0,100	0,08	0,045	0,05
9	0,064	0,05	0,035	0,03
10	0,054	0,06	0,041	0,04
11	0,294	0,23	0,274	0,21
12	0,083	0,09	0,069	0,08
13	0,198	0,17	0,236	0,19
14	0,089	0,07	0,050	0,05
15	0,058	0,04	0,026	0,02
16	0,094	0,07	0,048	0,05
17	0,239	0,18	0,220	0,17
18	0,079	0,08	0,070	0,08
19	0,146	0,14	0,202	0,16
20	0,072	0,06	0,055	0,06
21	0,048	0,04	0,029	0,02
22	0,107	0,08	0,059	0,06
23	0,195	0,15	0,189	0,15
24	0,082	0,08	0,077	0,08
25	0,137	0,11	0,171	0,13
26	0,085	0,06	0,052	0,05
27	0,050	0,04	0,017	0,01
28	0,101	0,08	0,059	0,05
29	0,165	0,13	0,151	0,12
30	0,092	0,07	0,074	0,07
31	0,140	0,11	0,139	0,10
32	0,102	0,08	0,054	0,05
33	0,052	0,04	0,016	0,01
34	0,088	0,07	0,051	0,05
35	0,116	0,09	0,111	0,09
36	0,093	0,07	0,069	0,05
37	0,131	0,10	0,099	0,07
38	0,100	0,08	0,048	0,04
39	0,055	0,04	0,014	0,01
40	0,078	0,06	0,044	0,04
41	0,091	0,07	0,079	0,06
42	0,085	0,06	0,051	0,04
43	0,100	0,08	0,070	0,06
44	0,083	0,06	0,039	0,03
45	0,051	0,04	0,011	0,01

	50 Hz		60 Hz	
	[A]	[% de In]	[A]	[% de In]
46	0,068	0,05	0,036	0,03
47	0,070	0,05	0,052	0,04
48	0,076	0,06	0,045	0,04
49	0,066	0,05	0,047	0,04
50	0,063	0,05	0,033	0,03

Tab. 4: Harmonics 50 Hz and Harmonics 60 Hz

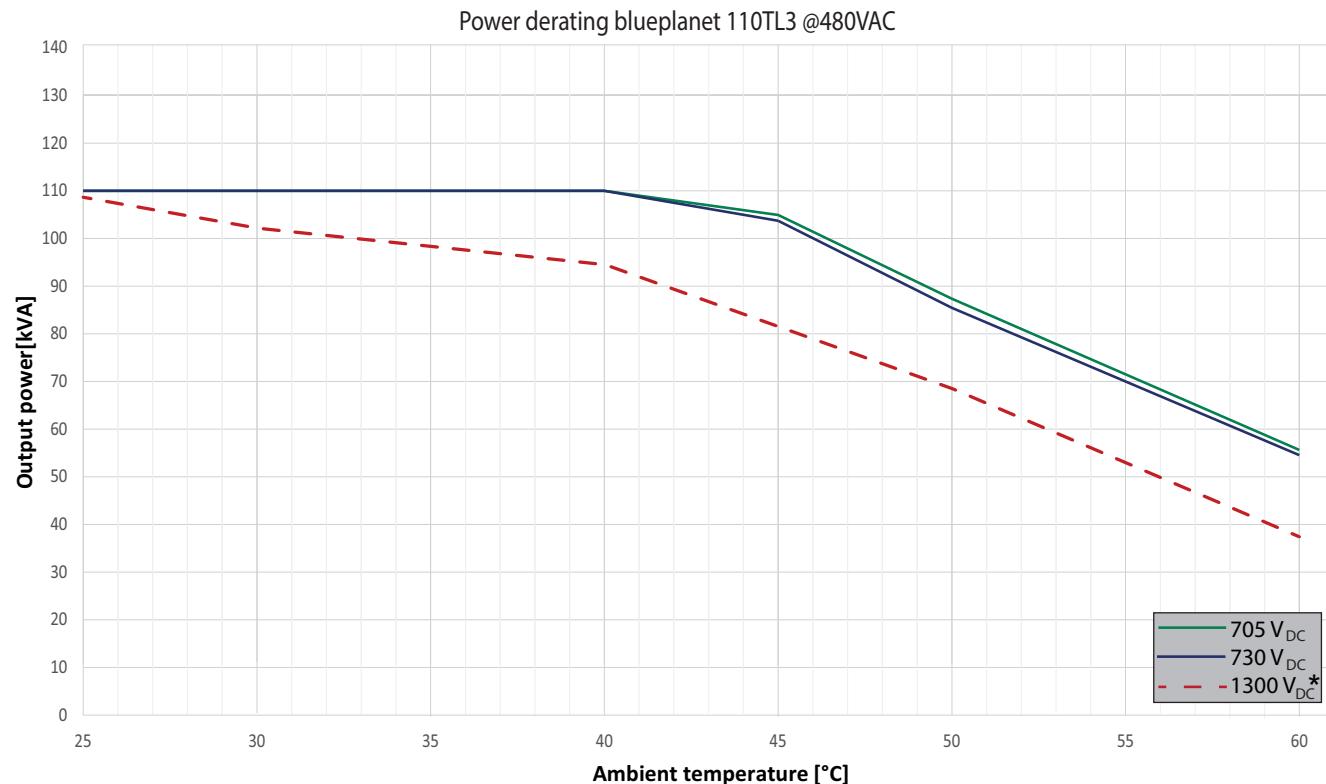


Fig. 14: Power derating blueplanet 110.0 TL3

*) Due to the thermal characteristics of solar modules an operational DC voltage of 1300VDC is not to be expected at higher ambient temperatures in the vast majority of system designs.

Efficiency characteristic

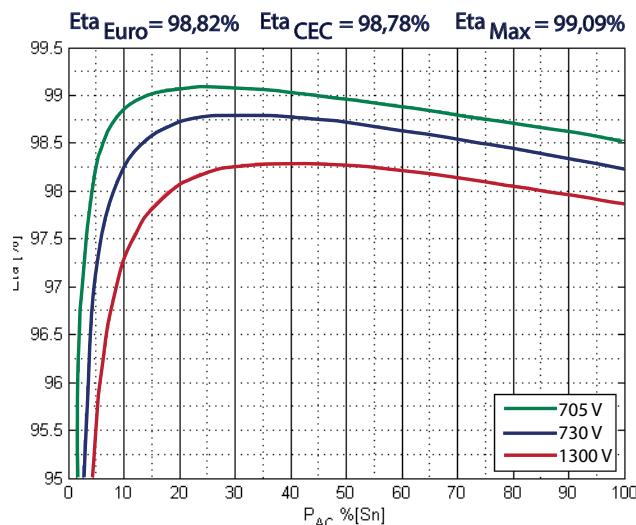


Fig. 15: 2D Diagram blueplanet 110 TL3

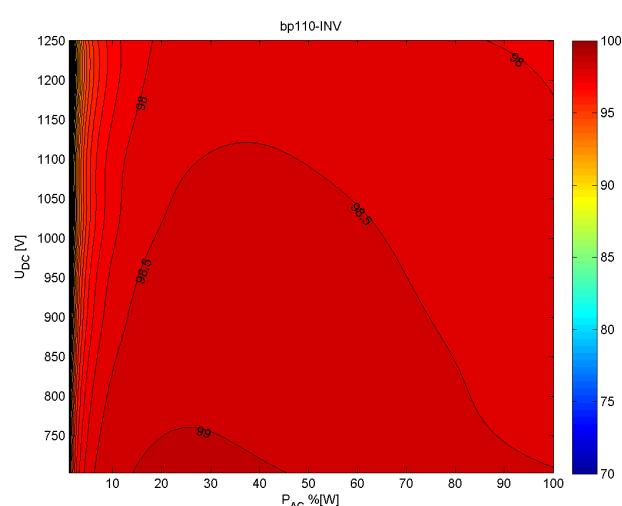


Fig. 16: 3D Diagram blueplanet 110 TL3

1.5 KACO blueplanet 125 TL3 US

AC-Power

Inverter power nominal	125 kVA
Inverter power maximal	125 kVA
Rated current (In)	152 A
Power electronics type	IGBT-MLI (self-commutated)
Rated operating voltage	480 V
cos phi nominal	≈ 1
Grid connection	Three-phase
Impedance bei 165 Hz *	$R_{165\text{ Hz}} \approx 360,0 \Omega$, $X_{165\text{ Hz}} \approx 100,0 \Omega$
Impedance bei 175 Hz *	$R_{175\text{ Hz}} \approx 47,0 \Omega$, $X_{175\text{ Hz}} \approx 360,0 \Omega$

* Scheme in parallel

Operating behaviour in the event of a short circuit at the inverter output

Maximum peak current (Ip)	260,8 A
Maximum peak current (Ik")	150,8 A

Power quality characteristics

Max. number of switching operations, N ₁₀	10
Max. number of switching operations, N ₁₂₀	120
Case of switching operation	Cut-in at 10 % of rated power
Grid impedance angle	30° 50° 70° 85°
Flicker step factor	0,0187 0,0279 0,0340 0,0358
Voltage change factor	0,0053 0,0053 0,0053 0,0053
Maximum inrush current factor	0,435
Maximum inrush current factor (transient only)	0,020

Case of switching operation	Cut-in at 100 % of rated power
Grid impedance angle	30° 50° 70° 85°
Flicker step factor	0,1370 0,1318 0,1250 0,1211
Voltage change factor	0,0382 0,0382 0,0382 0,0382
Maximum inrush current factor	0,435
Maximum inrush current factor (transient only)	0,020

Case of switching operation	Service disconnection at rated power
Description of the service disconnection procedure	Disconnection by the DC-switch
Grid impedance angle	30° 50° 70° 85°
Flicker step factor	0,3285 0,2505 0,1469 0,0642
Voltage change factor	0,0757 0,0757 0,0757 0,0757
Maximum inrush current factor	0,000
Maximum inrush current factor (transient only)	0,000
Worst case over all switching operations	0,328
Worst case over all switching operations (transient only)	0,040

Note: S_{k, fic}/S_n in the fictitious grid was set to 20

Flicker

	30°	50°	70°	85°
Grid impedance angle				
Flicker step factor	0,46	0,69	0,84	0,88
Short term flicker	0,21	0,32	0,38	0,40

Note: $S_{k, \text{flick}}/S_n$ in the fictitious grid was set to 20

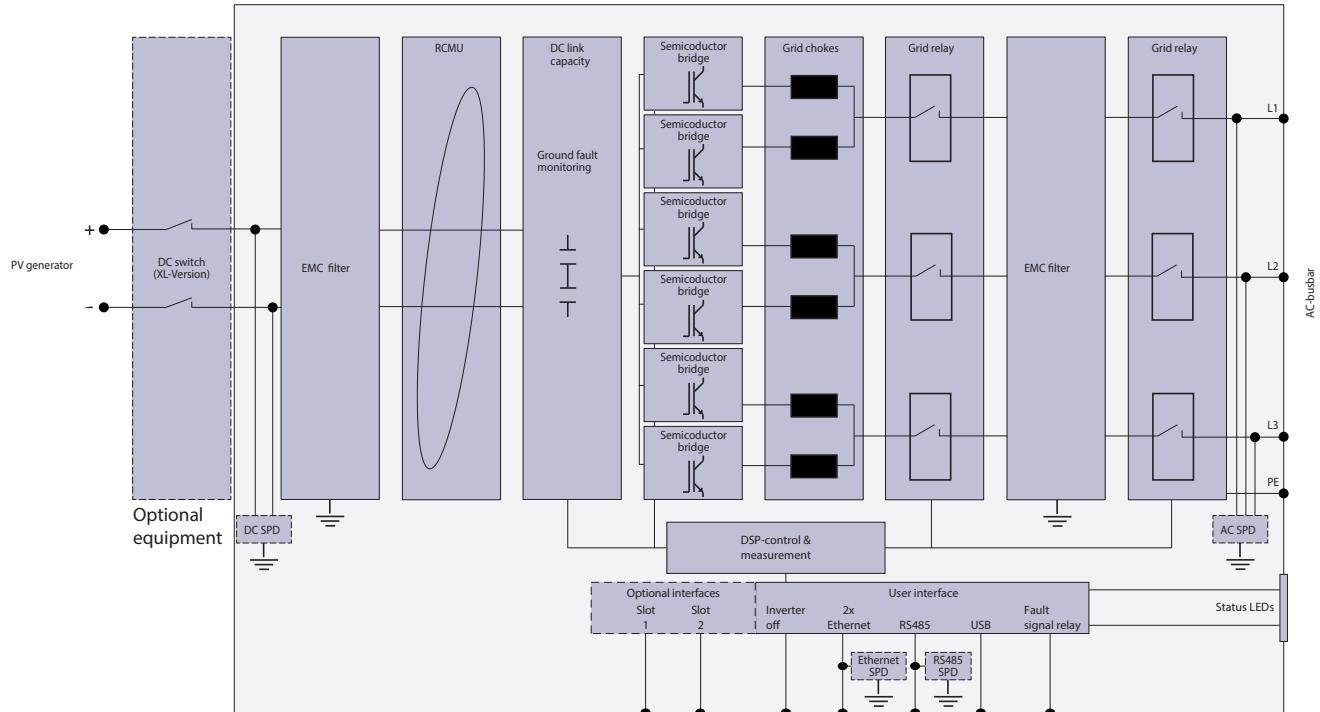


Fig. 17: Block schema blueplanet 87.0-165 TL3

	50 Hz	
	[A]	[% de In]
1	146,545	96,41
2	0,216	0,14
3	0,084	0,06
4	0,142	0,09
5	0,628	0,41
6	0,127	0,08
7	0,570	0,37
8	0,087	0,06
9	0,077	0,05
10	0,110	0,07
11	0,277	0,18
12	0,128	0,08
13	0,252	0,17
14	0,084	0,06
15	0,082	0,05
16	0,136	0,09
17	0,231	0,15
18	0,121	0,08
19	0,218	0,14
20	0,070	0,05
21	0,084	0,06
22	0,142	0,09
23	0,186	0,12
24	0,107	0,07
25	0,174	0,11
26	0,062	0,04
27	0,076	0,05
28	0,116	0,08
29	0,173	0,11
30	0,090	0,06
31	0,168	0,11
32	0,058	0,04
33	0,061	0,04
34	0,080	0,05
35	0,161	0,11
36	0,083	0,05
37	0,151	0,10
38	0,056	0,04
39	0,054	0,04
40	0,044	0,03
41	0,144	0,09
42	0,079	0,05
43	0,132	0,09
44	0,050	0,03
45	0,035	0,02

50 Hz		
	[A]	[% de In]
46	0,041	0,03
47	0,106	0,07
48	0,075	0,05
49	0,089	0,06
50	0,051	0,03

Tab. 5: Harmonics 50 Hz

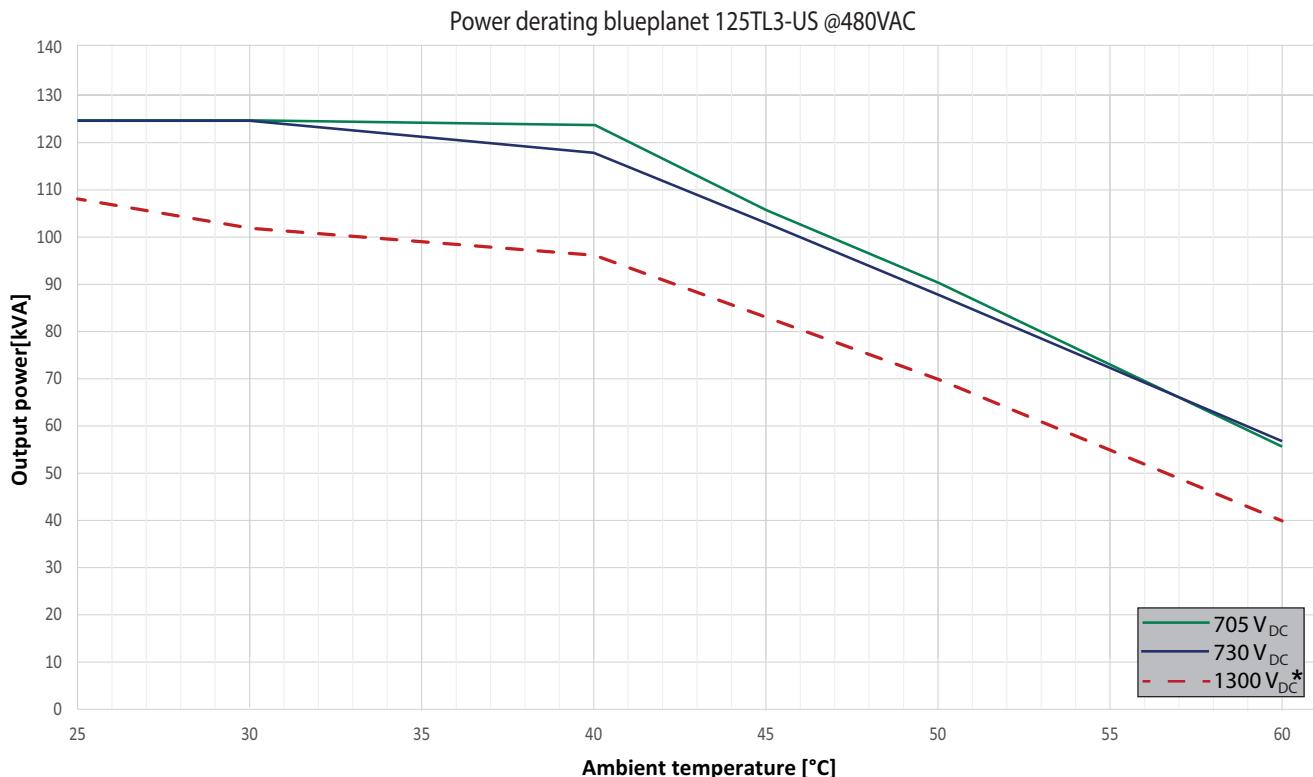


Fig. 18: Power derating blueplanet 125 TL3 US

*) Due to the thermal characteristics of solar modules an operational DC voltage of 1300VDC is not to be expected at higher ambient temperatures in the vast majority of system designs.

Efficiency characteristic

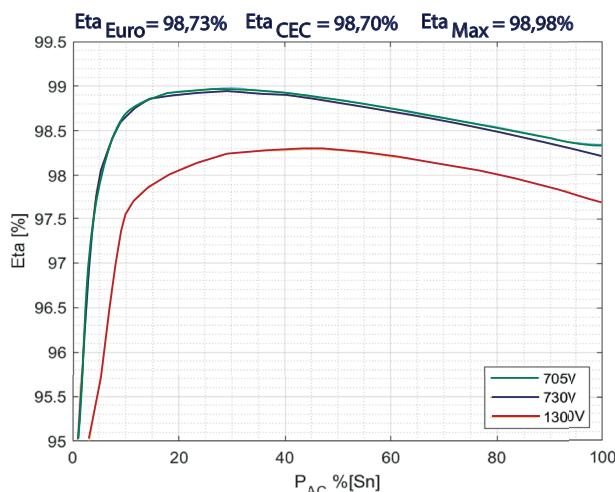


Fig. 19: 2D Diagram blueplanet 125 US

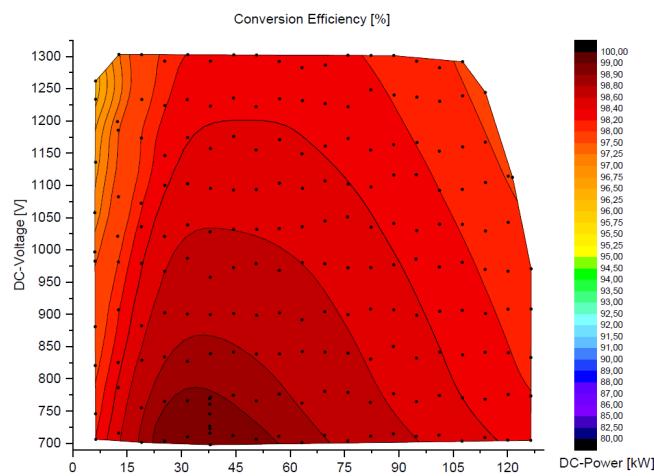


Fig. 20: 3D Diagram blueplanet 125 US